

LAB REPORT: MECHANICAL SIEVE ANALYSIS

Sample No. **G29** Date Sampled **22-Jun-18** By **TK** of **Kosick Aggregates Ltd.**
 Location **Kosick's Taylor Pit, Taylor, B.C.** Sample Type **Pail** Natural Moisture **1.0** %
 Description **12.5 mm Graded Aggregate Seal** Tech **CH**


Specifications **2016 British Columbia Ministry of Transportation and Infrastructure Gradation Limits For Graded Aggregate Seal, Section 508 - Table 508-A, Class D.**


Comments	Fracture	Method
	N/A	N/A

Sieve Results

Sieve mm	12.5	9.5	4.75	0.600	0.075
% Passing	100.0	99.9	22.5	2.3	1.3
Specification	100-100	30-80	25-45	5-20	0-3

By Type Gravel = **77.4%** Sand = **21.3%** Silt & Clay = **1.3%**

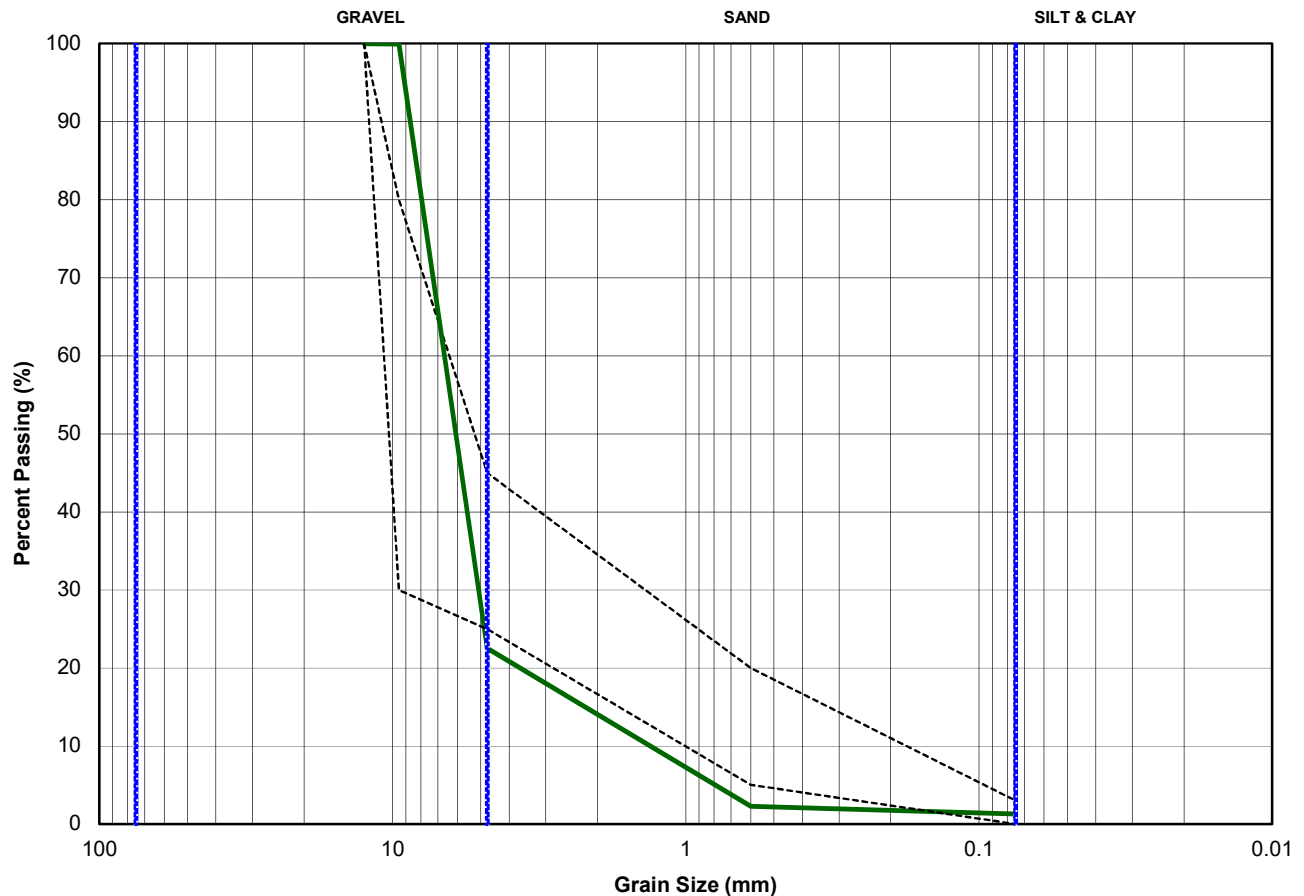

	#109, 8715 109st Grande Prairie, AB T8V 8H7 780-978-9052	Client Kosick Aggregates Ltd.	Date 26-Jun-18
		Project 2018 Material Testing	File No. 1104-001-00
		Location Taylor, British Columbia	Sample No. G29